


- 24.00 ( Mast 87 )
- 27.00 ( Mast 103, 118 )
- 30.00 ( Mast 25, 85, 110, 121, 138 )
- 33.00 ( Mast 11, 91, 92, 117, 129 )
- 36.00 ( Mast 44, 80, 97, 100, 105 )
- 39.00 ( Mast 65, 94, 125, 132, 136 )
- 42.00 ( Mast 81 )
- 48.00 ( Mast 126, 133 )

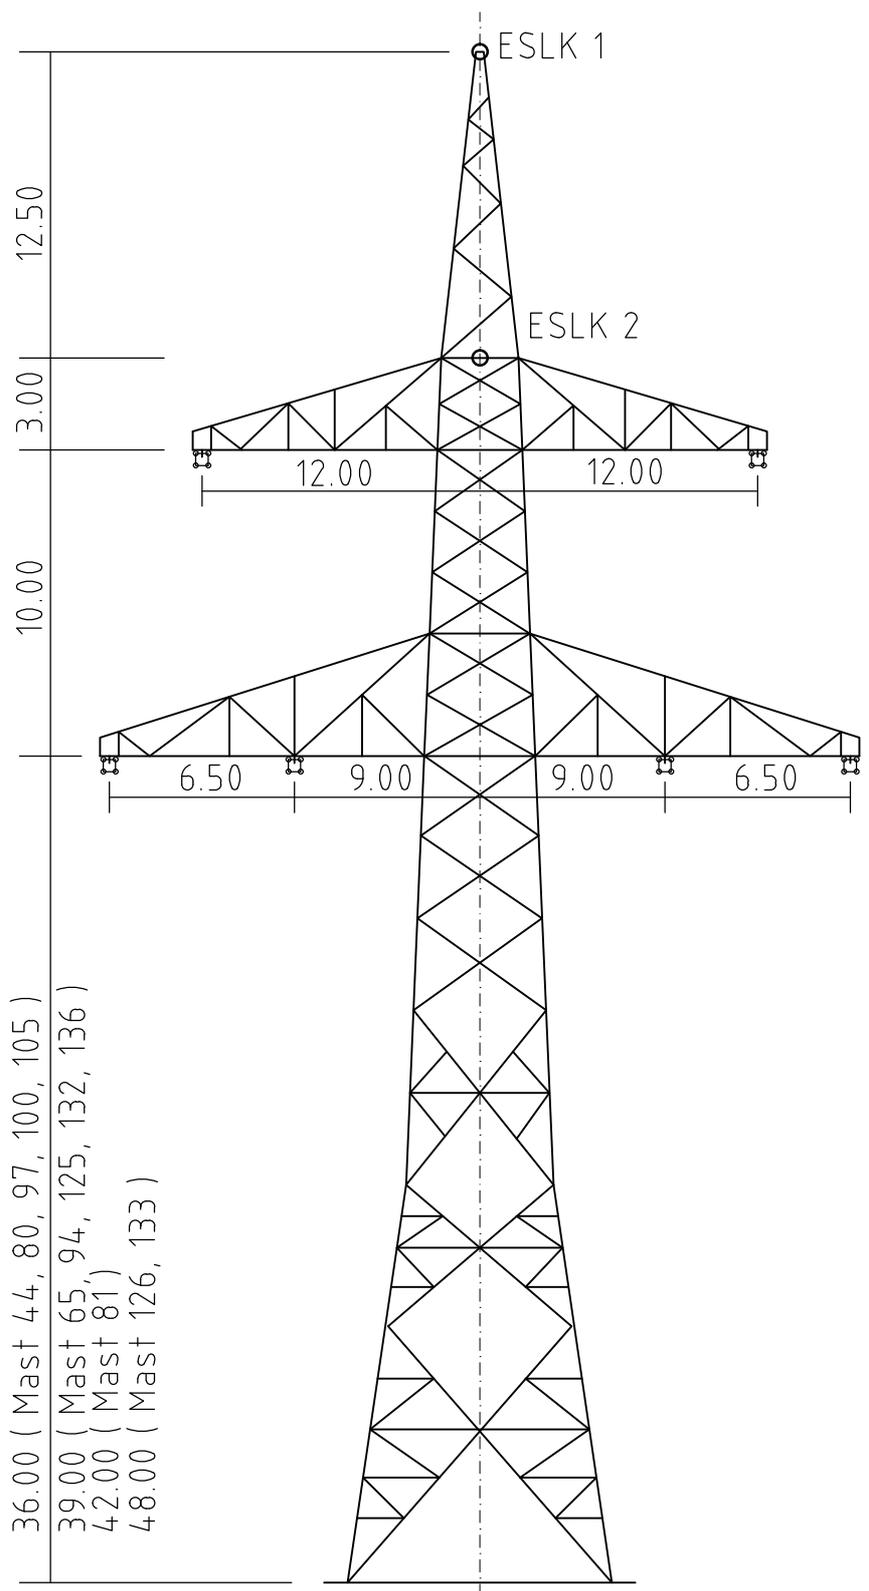

Mast Nr. 11, 25, 44, 65, 80-81, 85, 87, 91, 92, 94, 97, 100, 103, 105, 110, 117, 118, 121, 125-126, 129, 132, 133, 136, 138

 Aufgestellt : Bayreuth 08.01.2018 TenneT TSO GmbH i.V.  i.A. 	Erstellt durch 	Datum 27.11.2017 Erstelldatum 27.10.2017	Status Planung	Zählteil 18 Blatt 5
	Objektname : 380-kV-Leitung Altheim - Matzenhof Teilabschnitt 2: 380-kV-Ltg. Adlkofen-Matzenhof B152			
Klassifikation Mastprinzipzeichnung (D-2-D-2015.3)		ohne Maßstab		
Titel WA140		Planfestellungsunterlage		Anlage 6.0